



International Journal of Advance Engineering and Research Development

Volume 4, Issue 12, December -2017

REVIEW AND ANALYSIS OF DIRECTIONAL PROTECTION SCHEME FOR HVDC TRANSMISSION LINES BASED ON REACTIVE ENERGY

Hemali Dixit¹, Zalak Shah²

¹PG Scholar, Electrical Department, LDRP-ITR, Gandhinagar, Gujarat, India

²Assisatnt Professor, Electrical Department, LDRP-ITR, Gandhinagar, Gujarat, India

ABSTRACT:- As we see modern civilization heavily depends on consumption of electrical energy for commercial, industrial, domestic, agricultural and social purposes. HVDC is most economical way to transmit bulk power over longer distances, complexity in controlling of the power flow, asynchronous power grid interconnections and renewable energy integration due to its flexible power control. Among the numerous techniques concerning HVDC system, DC transmission line protection is one of the important unit thus it provides fast fault clearance and guarantees the operation security of the entire HVDC transmission system. In HVDC transmission lines uses the voltage differential protection in which voltage differential rate to identify the faults takes place on transmission line but this technique not efficient due to not detect high impedance faults and its sensitivity to faults resistance.

In the time difference between the initial wave and reflected wave from the fault point is utilized to calculate the fault distance, but it is difficult to distinguish the reflected wave from the disturbing waves in some cases. This project proposes a novel directional backup protection scheme based on reactive energy for HVDC transmission systems. In this paper reactive energy is defined as the integral of reactive power during a period of time.

INTRODUCTION

As we see modern civilization heavily depends on consumption of electrical energy for commercial, industrial, domestic, agricultural and social purposes. HVDC is most economical way to transmit bulk power over longer distances, complexity in controlling of the power flow, asynchronous power grid interconnections and renewable energy integration due to its flexible power control. Among the numerous techniques concerning HVDC system, DC transmission line protection is one of the important unit thus it provides fast fault clearance and guarantees the operation security of the entire HVDC transmission system. In HVDC transmission lines uses the voltage differential protection in which voltage differential rate to identify the faults takes place on transmission line but this technique not efficient due to not detect high impedance faults and its sensitivity to faults resistance. In high-speed travelling wave based protection to transmission line, but its performance is easily affected by disturbance takes place in system. Distance protection is another method to identify the faults take place on transmission line by fault distance calculation. In the time difference between the initial wave and reflected wave from the fault point is utilized to calculate the fault distance, but it is difficult to distinguish the reflected wave from the disturbing waves in some cases.

As we see modern civilization heavily depends on consumption of electrical energy for commercial, industrial, domestic, agricultural and social purposes. HVDC is most economical way to transmit bulk power over longer distances, complexity in controlling of the power flow, asynchronous power grid interconnections and renewable energy integration due to its flexible power control. Among the numerous techniques concerning HVDC system, DC transmission line protection is one of the important unit thus it provides fast fault clearance and guarantees the operation security of the entire HVDC transmission system. In HVDC transmission lines uses the voltage differential protection in which voltage differential rate to identify the faults takes place on transmission line but this technique not efficient due to not detect high impedance faults and its sensitivity to faults resistance. In high-speed travelling wave based protection to transmission line, but its performance is easily affected by disturbance takes place in system. Distance protection is another method to identify the faults take place on transmission line by fault distance calculation.

In the time difference between the initial wave and reflected wave from the fault point is utilized to calculate the fault distance, but it is difficult to distinguish the reflected wave from the disturbing waves in some cases. This project proposes a novel directional backup protection scheme based on reactive energy for HVDC transmission systems. In this project reactive energy is defined as the integral of reactive power during a period of time. The Hilbert transform is employed to continuously calculate the reactive energy, and then, the reactive energy flow directions are applied to identify internal and external faults. Compared to the traditional current differential scheme, this protection has a smaller time delay, thus significantly increasing the protection speed. Various simulation results indicate that the proposed protection per-forms well under various situations, and the sensitivity and reliability of the protection are satisfactory.

HVDC SYSTEM

Historical Perspective on HVDC Transmission It has been widely documented in the history of the electricity industry, that the first commercial electricity generated (by Thomas Alva Edison) was direct current (DC) electrical power. The

first electricity transmission systems were also direct current systems. However, DC power at low voltage could not be transmitted over long distances, thus giving rise to high voltage alternating current (AC) electrical systems. Nevertheless, with the development of high voltage valves, it was possible to once again transmit DC power at high voltages and over long distances, giving rise to HVDC transmission systems.

➤ The HVDC technology

The fundamental process that occurs in an HVDC system is the conversion of electrical current from AC to DC (rectifier) at the transmitting end, and from DC to AC (inverter) at the receiving end. There are three ways of achieving conversion:-

- ✚ Natural Commutated Converters. Natural commutated converters are most used in the HVDC systems as of today. The component that enables this conversion process is the thyristor, which is a controllable semiconductor that can carry very high currents (4000 A) and is able to block very high voltages (up to 10 kV). By means of connecting the thyristor in series it is possible to build up a thyristor valve, which is able to operate at very high voltages (several hundred of kV). The thyristor valve is operated at net frequency (50 Hz or 60 Hz) and by means of a control angle it is possible to change the DC voltage level of the bridge. This ability is the way by which the transmitted power is controlled rapidly and efficiently.
- ✚ Capacitor Commutated Converters (CCC). An improvement in the thyristor-based commutation, the CCC concept is characterized by the use of commutation capacitors inserted in series between the converter transformers and the thyristor valves. The commutation capacitors improve the commutation failure performance of the converters when connected to weak networks.
- ✚ Forced Commutated Converters. This type of converters introduces a spectrum of advantages, e.g. feed of passive networks (without generation), independent control of active and reactive power, power quality. The valves of these converters are built up with semiconductors with the ability not only to turn-on but also to turn-off. They are known as VSC (Voltage Source Converters). Two types of semiconductors are normally used in the voltage source converters: the GTO (Gate Turn-Off Thyristor) or the IGBT (Insulated Gate Bipolar Transistor). Both of them have been in frequent use in industrial applications since early eighties. The VSC commutes with high frequency (not with the net frequency). The operation of the converter is achieved by Pulse Width Modulation (PWM). With PWM it is possible to create any phase angle and/or amplitude (up to a certain limit) by changing the PWM pattern, which can be done almost instantaneously. Thus, PWM offers the possibility to control both active and reactive power independently. This makes the PWM Voltage Source Converter a close to ideal component in the transmission network. From a transmission network viewpoint, it acts as a motor or generator without mass that can control active and reactive power almost instantaneously.

The components of an HVDC transmission system To assist the designers of transmission systems, the components that comprise the HVDC system, and the options available in these components, are presented and discussed. The three main elements of an HVDC system are: the converter station at the transmission and receiving ends, the transmission medium, and the electrodes.

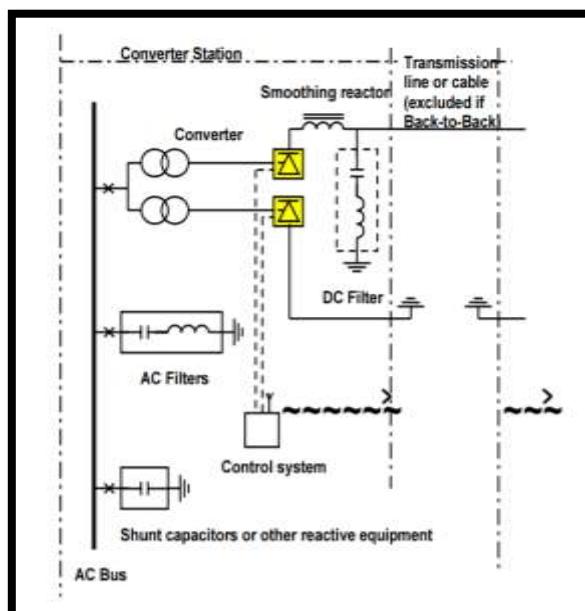


Fig 3.1- Block Diagram of HVDC System

Design, Construction, Operation and Maintenance considerations: -

In general, the basic parameters such as power to be transmitted, distance of transmission, voltage levels, temporary and continuous overload, status of the network on the receiving end, environmental requirements etc. are required to initiate a design of an HVDC system. For tendering purposes a conceptual design is done following a technical specification or in close collaboration between the manufacturer and the customer. The final design and specifications are in fact the result of the tendering and negotiations with the manufacturers/suppliers. It is recommended that a turnkey approach be chosen to contract execution, which is the practice even in developed countries.

DIRECTIONAL PROTECTION SYSTEM

PRINCIPLE OF PROTECTION SCHEME

In HVDC systems mostly transmit active power under normal operating condition, but in fault condition the less amount of reactive power flow due to small harmonic components in systems. The harmonic reactive power generated on the DC line depends on components of system like DC filters and the smoothing reactors. The total quantities of the harmonic current and voltage are typically less than 10% to 15% of the rated values. When DC line fault occurs, the current and voltage at the terminals of the DC line will contain a transient due to the inductive and capacitive components in the system, thus resulting in significant reactive power flows on the DC line. In traditional HVDC systems, shunt capacitor banks are commonly used for compensating the reactive power which the converters consume due to sudden change in firing angle. Reactive power control is designed to maintain the reactive power balance by switching the capacitor banks.

➤ **Reactive Energy Measurement**

In digital signal processing Hilbert transform is useful method for determine instantaneous attributes of time series, especially the amplitude and frequency. It is used to calculate the reactive power, which is defined as follows:-

$$\hat{x}(t) = x(t) * h(t) = x(t) * \frac{1}{\pi t} = \frac{1}{\pi} \int_{-\infty}^{\infty} \frac{x(\tau)}{t-\tau} d\tau \quad (1)$$

Where

$\hat{x}(t)$ Is the Hilbert transform result of $x(t)$ and '*' is the operator for time domain convolution.

The frequency characteristic of $h(t)$ is expressed in (eq.2). $h(t)$ induces a -90 degree shift for positive frequency components and a +90 degree shift for negative frequency components.

$$H(\omega) = -j \operatorname{sgn}(\omega) = \begin{cases} -j & \text{for } \omega < 0 \\ 0 & \text{for } \omega = 0 \\ j & \text{for } \omega > 0 \end{cases} \dots (2)$$

The Hilbert transform can be discretized as,

$$\hat{x}[n] = x[n] * h[n] \quad \dots (3)$$

Where

$$h[n] = \begin{cases} 0 & \text{for } n \text{ is even} \\ \frac{2}{n\pi} & \text{for } n \text{ is odd} \end{cases} \dots (4)$$

A Hamming window function is used to truncate $h[n]$ for finite calculations in practice.

The instantaneous reactive power is the multiplication of the current signal $i(t)$ and the Hilbert transform of the voltage signal $v(t)$

$$q(t) = \hat{v}(t) * i(t) \quad \dots (5)$$

The reactive energy during a period of time t is calculated in

$$W(t) = \int_0^t q(\tau) d\tau = \int_0^t \hat{v}(\tau) * i(\tau) d\tau \quad \dots (6)$$

➤ **Fault Direction Identification**

Directional protection scheme is used for internal and external fault identification. The reference direction of reactive energy is from the rectifier side to the inverter side. If the reactive energies of each side have different directions, an internal fault is identified. Otherwise, an external fault is detected. Thus, the fault direction identification criteria can be expressed as-

$$\text{internal fault : } W_R(t)W_I(t) < 0 \quad \dots (5.1)$$

$$\text{external fault : } W_R(t)W_I(t) > 0 \quad \dots (5.2)$$

Where $W_R(t)$ and $W_I(t)$ are the reactive energies measured at the rectifier side and inverter side, respectively. In a monopolar HVDC system, single pole reactive energy is used for direction identification, whereas in a bipolar system, the sum of the reactive energies at the two poles is used.

➤ **Start-up Component**

A protection start up component is introduced to ensure the reliability of the protection scheme in case of disturbances. In this study, the DC voltage differential du/dt or current differential di/dt is used as the start-up component. Once the start-up requirement is satisfied, the protection scheme is triggered to start the calculation process.

➤ **Time Delay**

Frequent energy exchange due the inductive and capacitive components at the beginning of the fault so the reactive energy varies between positive and negative values, which results in fluctuate directions during this period. So time delay is required to prevent this fluctuating nature of reactive energy direction.

➤ **Threshold Setting**

A threshold for the reactive energy is necessary to preventable-operation during disturbances. When the calculated reactive energy is larger than the threshold value, the fault direction identification module is activated.

➤ **Fault Pole identification**

In a bipolar HVDC transmission system, during single pole to ground fault pole selection is required to isolate faulty pole and maintain continues operation of system through another pole. Due to the mutual coupling effect of the two poles, the healthy pole may also generate reactive energy during a single-pole to ground fault, but this reactive energy is considerably smaller than that in the faulty pole. By which three types of faults can be classified.

When $k \leq 1/k_{set}$, the fault pole is determined as the negative pole, whereas a positive pole fault results when $k \geq k_{set}$ where k_{set} is the setting threshold of the pole selection coefficient. The fault is considered a bipolar fault when $1/k_{set} < k < k_{set}$. Where k is the ratio of reactive energy at positive pole and reactive energy at negative pole.

$$K = |W_{pos}(t)/W_{neg}(t)| \quad \dots \dots (5.3)$$

➤ **Flow Diagram**

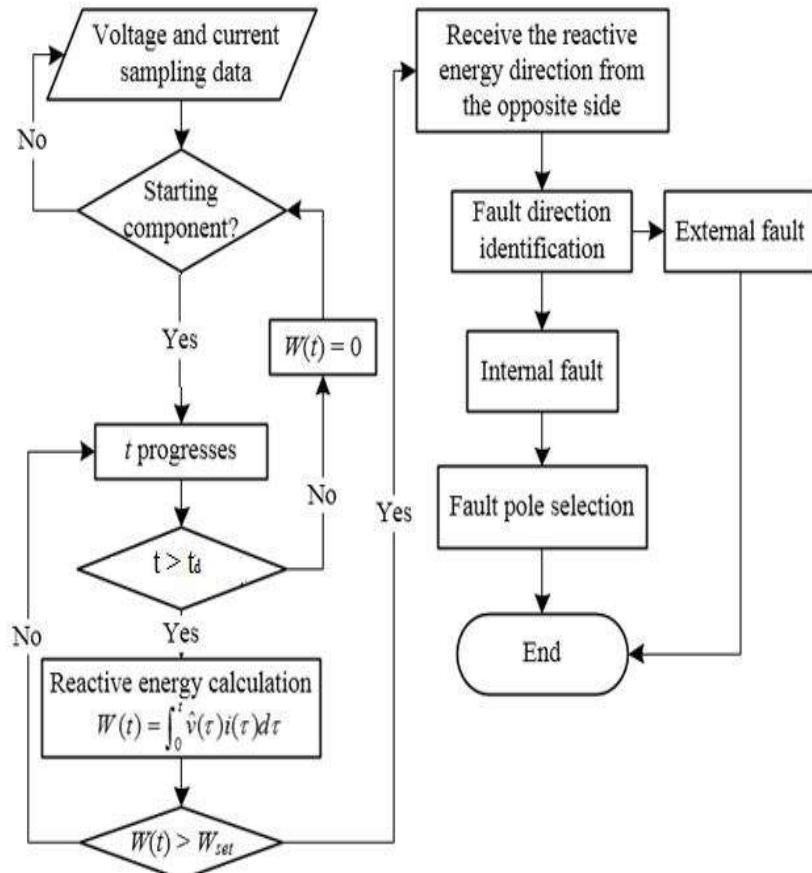


Fig.4.1 Flowchart of protection scheme

The protection scheme integrated flow diagram is shown in Fig. 4.1. When faults occur the start-up condition is satisfied. As time progresses t is incremented. When the time delay is satisfied, the protection scheme begins to calculate reactive energy from fault voltage and fault current. If the calculated reactive energy is larger than the setting threshold value of reactive energy, an internal or external fault can be identified according to the reactive energy directional information from the other side. Finally, the faulty pole is selected in the internal fault situation by measuring the reactive energy on both poles.

MODELLING AND SIMULATION

Matlab Model of HVDC system with internal Fault:-

The Matlab model of the HVDC proposed system with internal fault is shown in the fig below. The simulation results of Voltage and Current also shows the unbalancing due to internal fault in HVDC system.

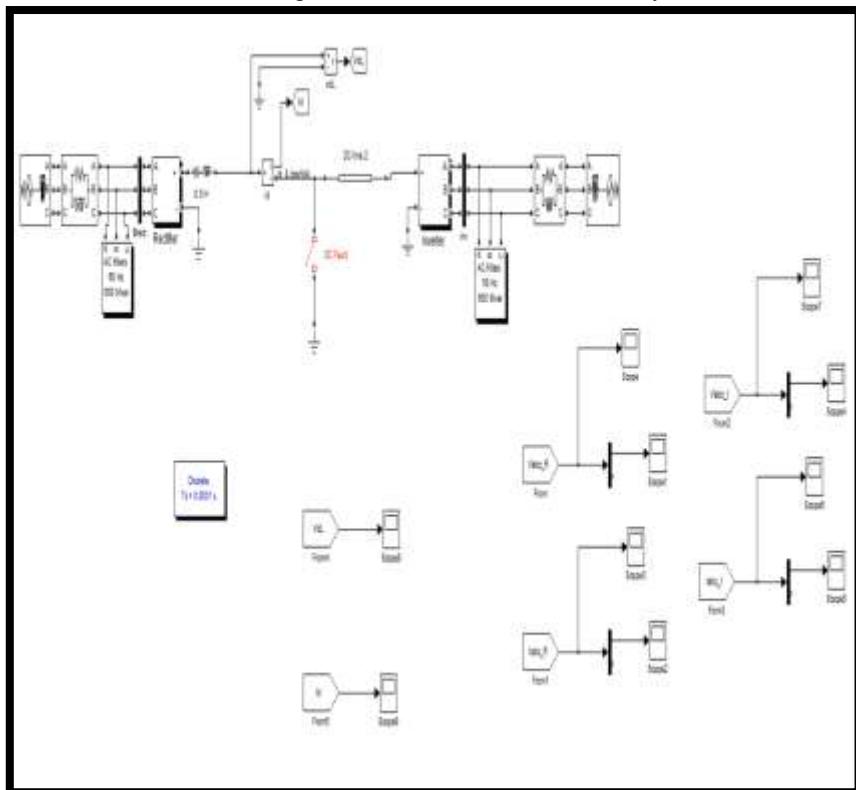


Fig 5.1- Matlab Model of HVDC System with Fault

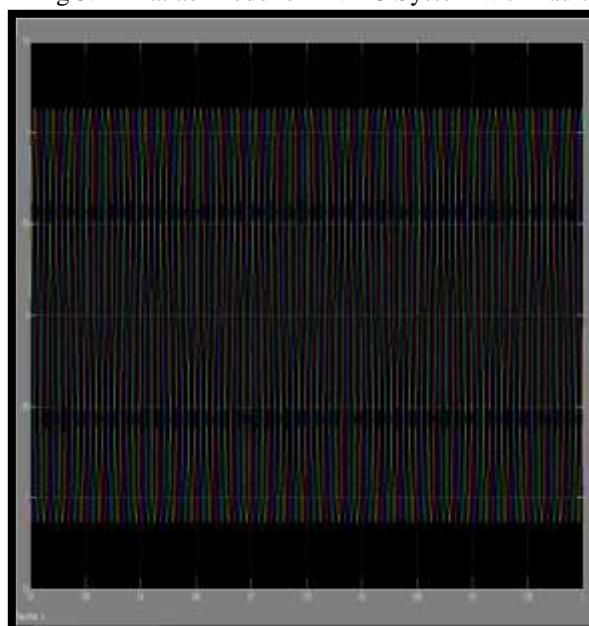


Fig 5.2- Source side voltage

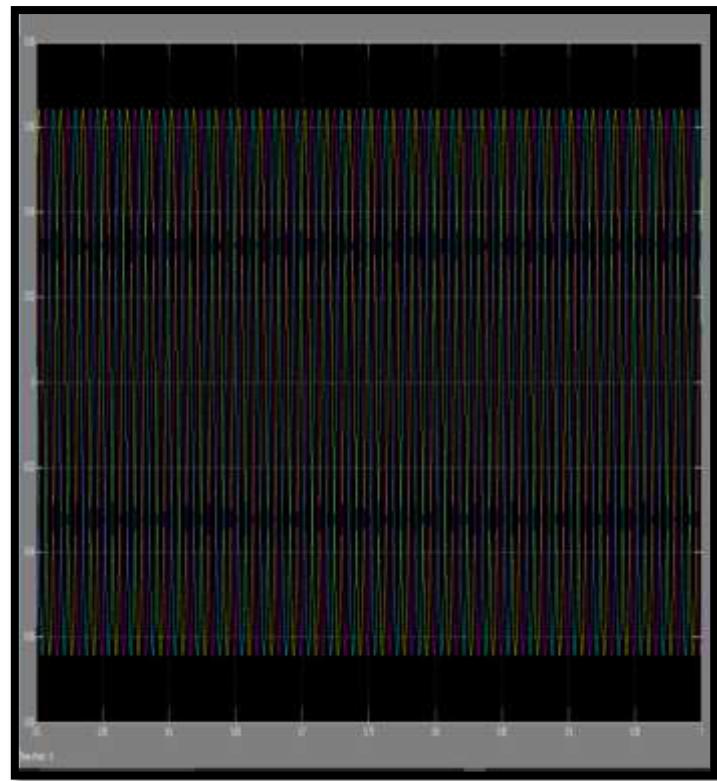


Fig 5.3- Source side current

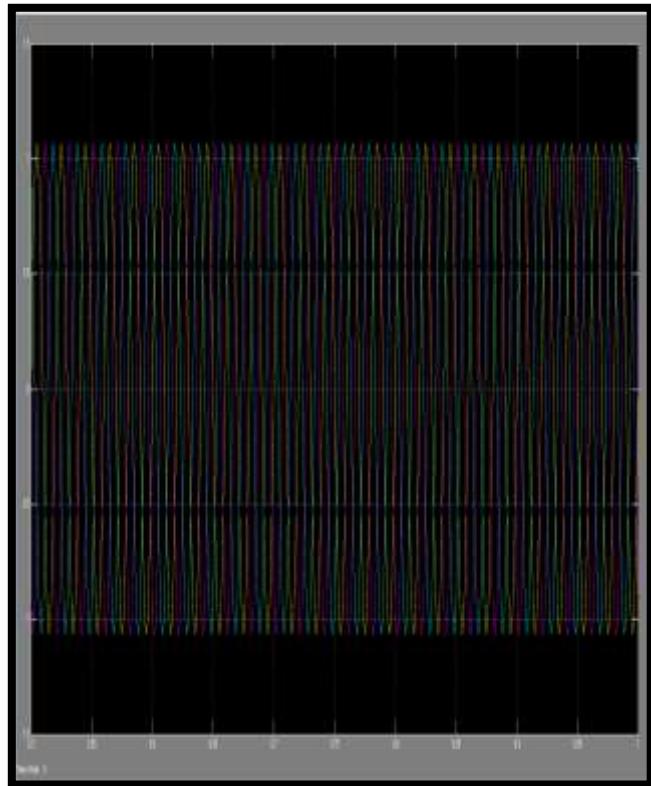


Fig 5.4-Inverter side voltage

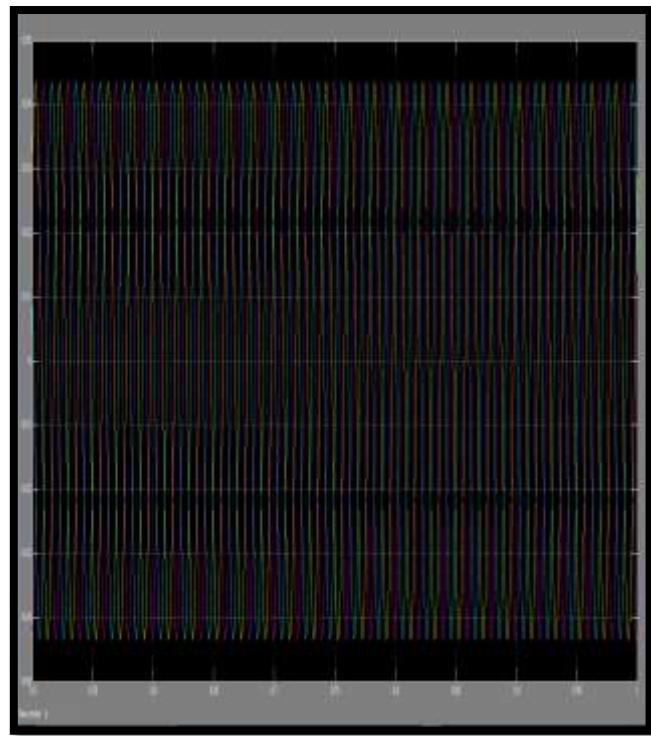


Fig 5.5- Inverter side current

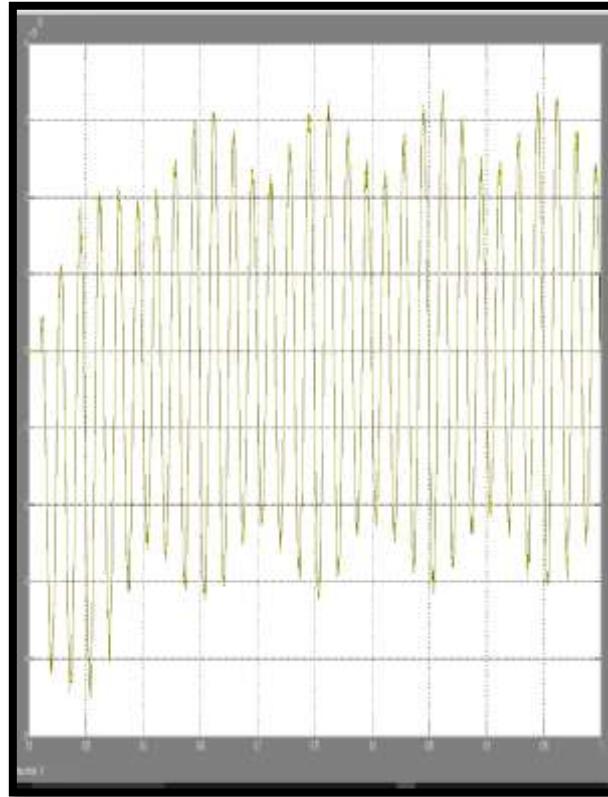


Fig 5.6- Voltage variation due to fault

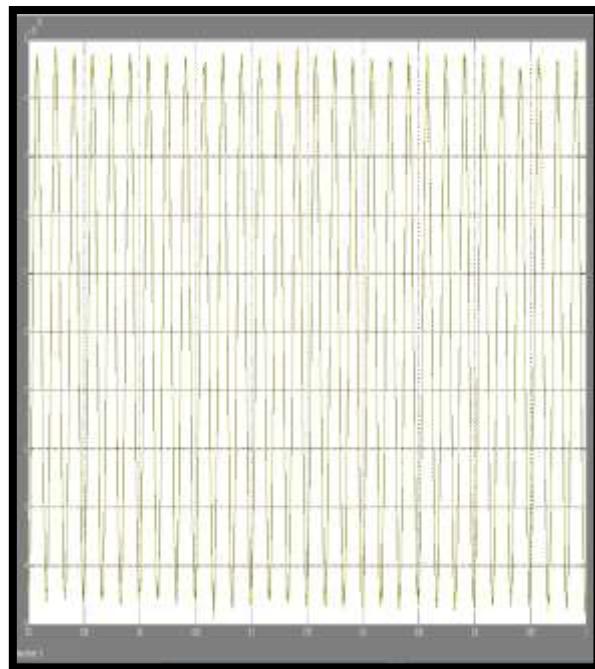


Fig 5.7-current variation due to fault

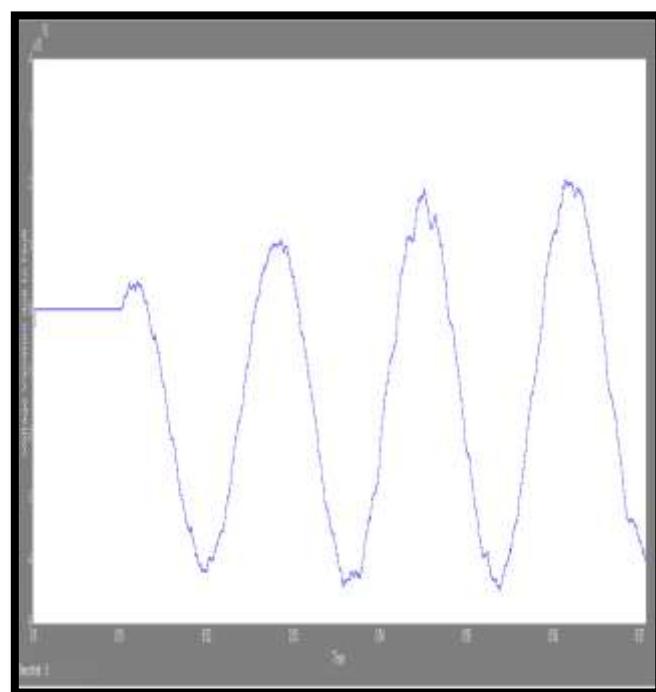


Fig 5.8- Voltage variation due to fault

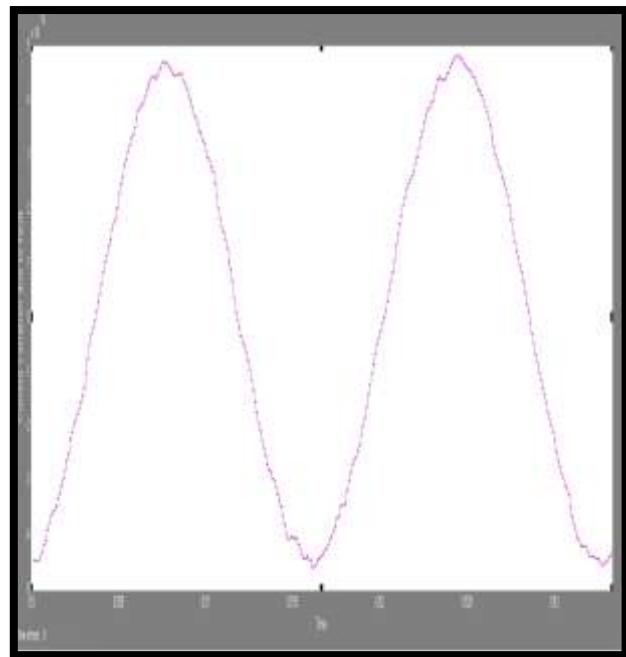


Fig 5.9-current variation due to fault

Matlab Model of Reactive power control with HVDC system for internal Fault:-

The Matlab model of Reactive power control with HVDC system for internal Fault is shown in the fig below. In the controlling block the Selective Harmonic Technique used for the angle control using Reactive power control and providing the protection against the internal fault. In the proposed control system the Source side voltage and the voltage from the fault condition has been compared for calculating the angle variation in the system than the required relation identify and make by PI controller and then give it to the triggering control block for Pulses control at Rectifier side, so we can control it provide reactive power control so mitigate the fault effect and provide stability in the HVDC System.

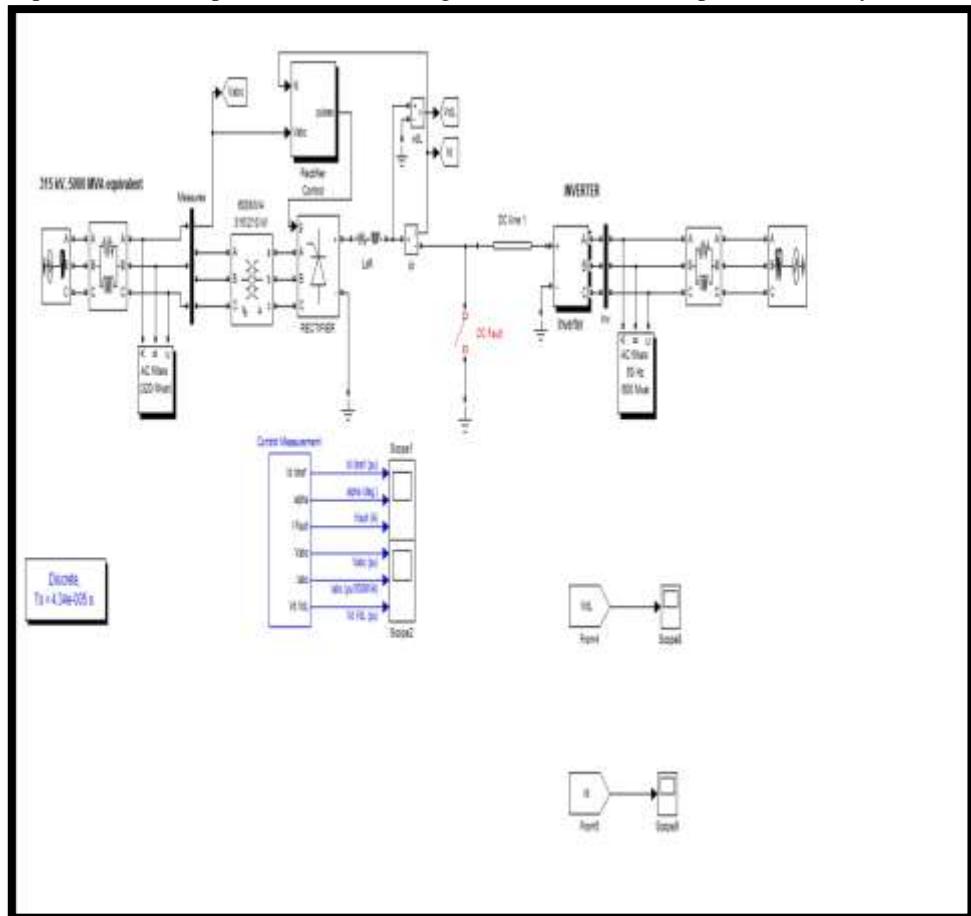


Fig 5.10- HVDC system with proposed control strategy

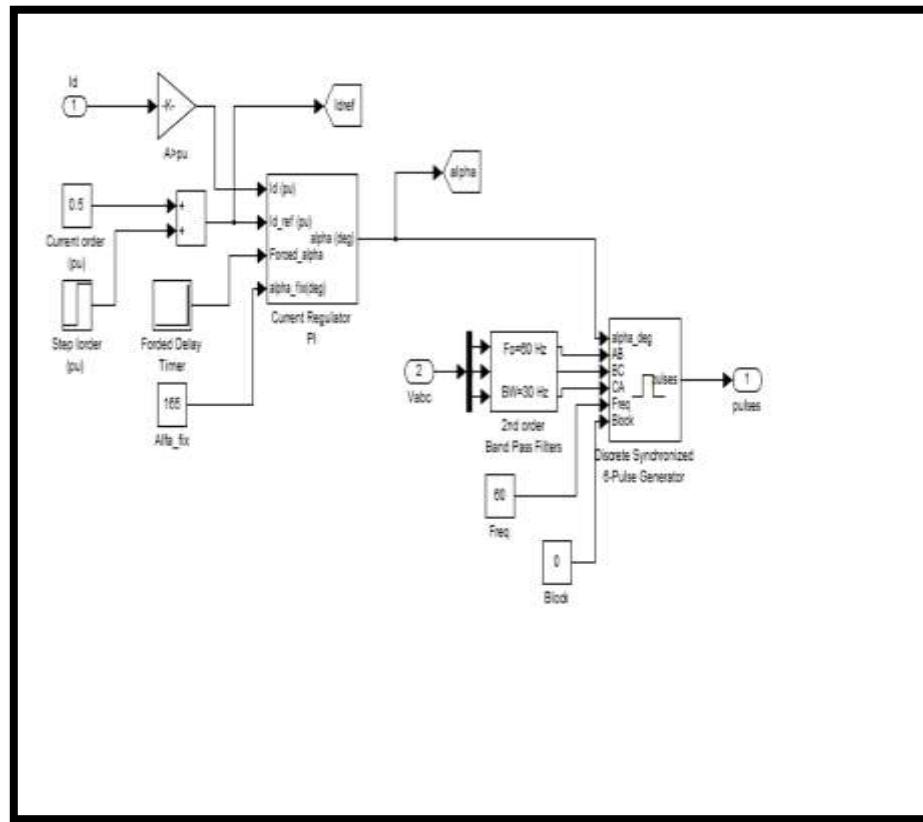


Fig 5.11- Control block for Reactive power control

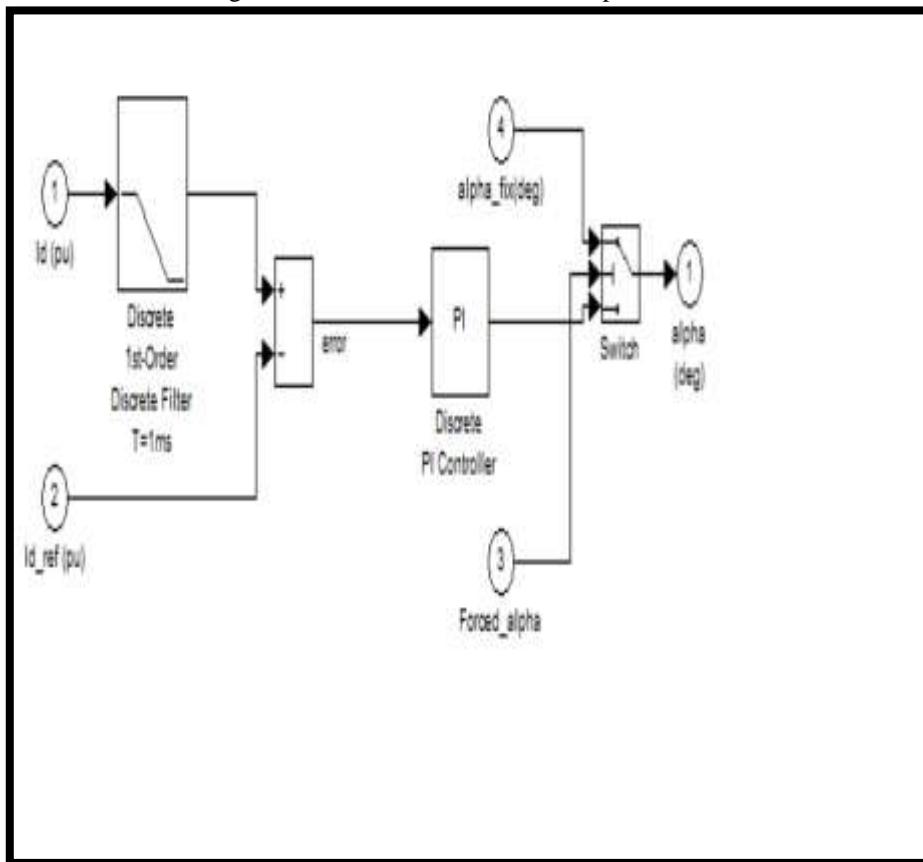


Fig 5.12- Angle controlling block

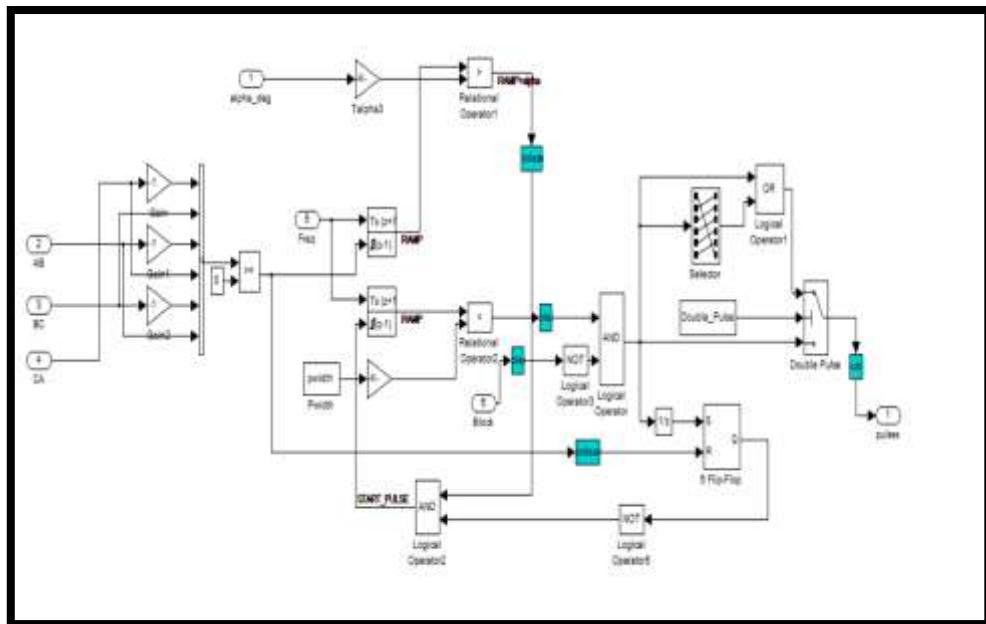


Fig 5.13- Triggering pulse control system at Rectifier side

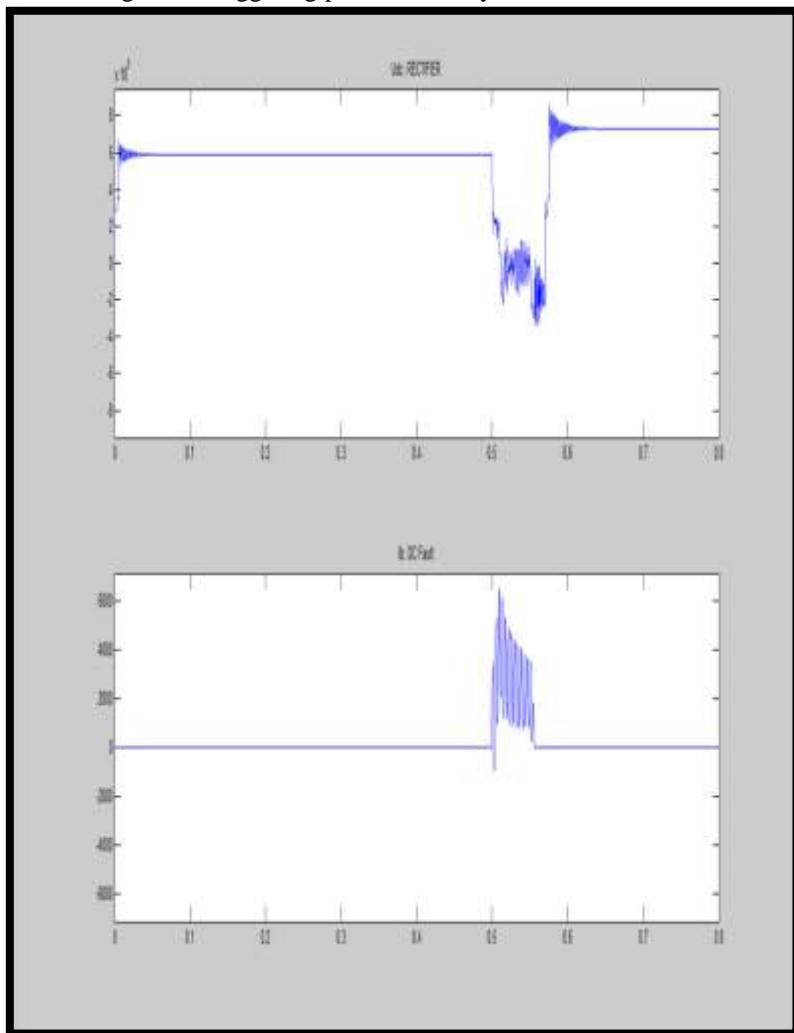


Fig 5.14- fault clearance and protection system time

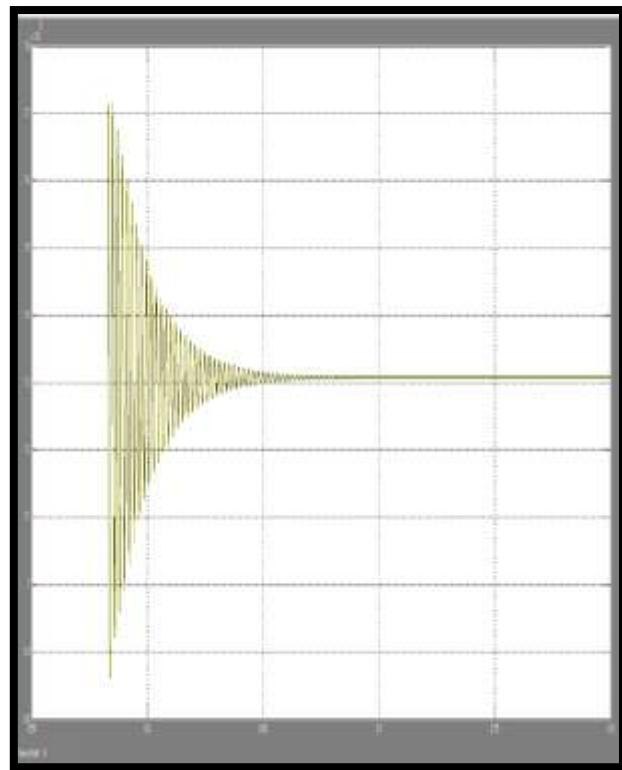


Fig 5.15- Stable voltage in HVDC after fault controlling

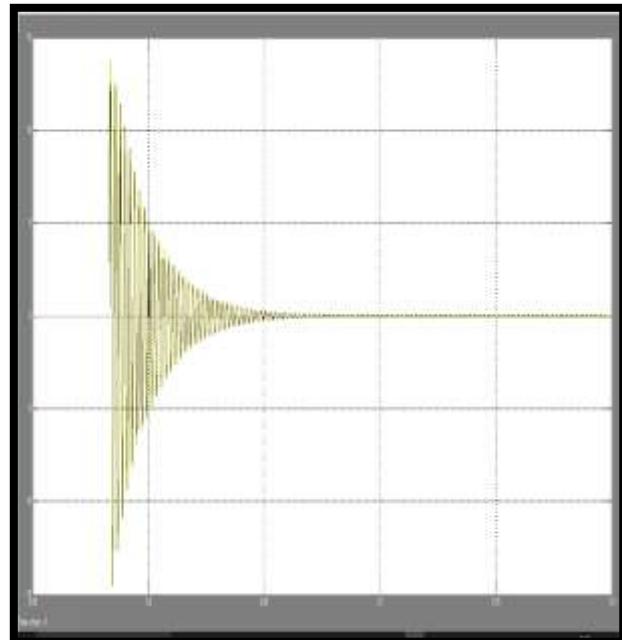


Fig 5.16- Stable current in HVDC after fault controlling

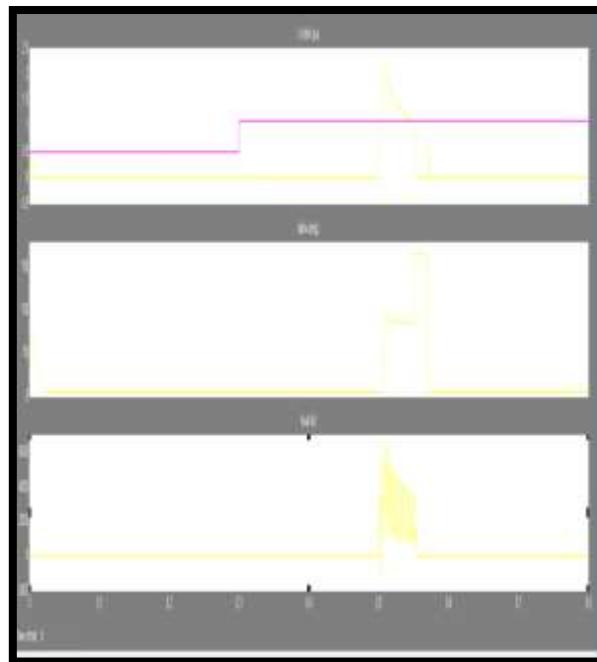


Fig 5.17- Controlling Parameters

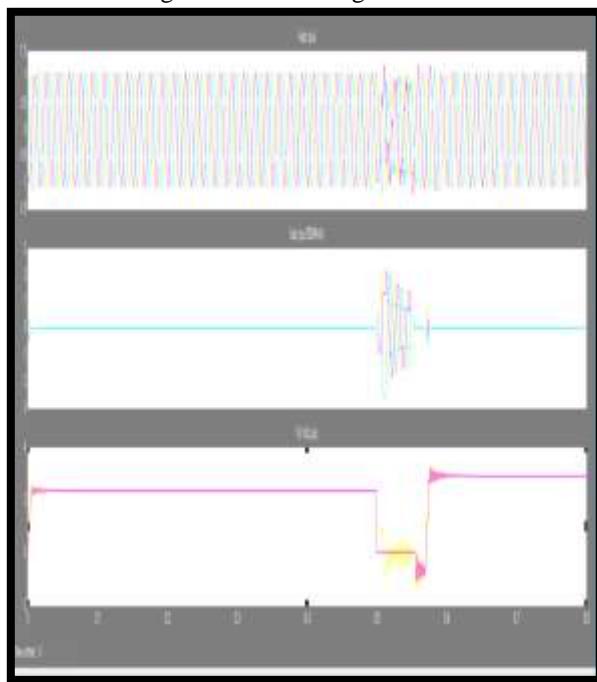


Fig 5.18- Compensated outputs

Conclusion

This paper proposes a novel protection scheme based on reactive energies for HVDC transmission lines. The selective harmonic technique is employed to calculate the reactive energy, which ensures the continuous outcome of the reactive energy and fault direction during the entire time of protection. The characteristics of the reactive energy under various fault conditions are analyzed based on the equivalent circuit of the HVDC system and applied to construct the direction protection.

Matlab simulations are conducted to verify the effectiveness of the protection scheme. The proposed protection scheme is correctly effective for internal fault, fault distance variations. Compared to current differential protection, this protection induces a smaller time delay, thus significantly accelerating fault detection. Moreover, the protection is adaptive to fault resistances, which guarantees the protection sensitivity.

REFERENCES

1. “A Directional Protection Scheme for HVDC Transmission Lines Based on Reactive Energy ” by Shuxin Luo, Xinzhou Dong, Shenxing Shi and Bin Wang
2. “A Novel Hybrid Directional Comparison Pilot Protection Scheme for the LCC-VSC Hybrid HVDC Transmission Lines”,by Yanting Wang and Baohui Zhang
3. “A Directional comparison Pilot Protection Scheme for Hybrid HVDC Transmission Lines” by Yanting wang, Baohui Zhang and Fei Kong
4. “A Novel Pilot Directional Protection Scheme for HVDC Transmission Line Based on Specific Frequency Current” by Jian Liu, Chun-ju Fan, and Neng-ling Tai,2014 International Conference on Power System Technology
5. “Development of a Novel Protection Device for Bipolar HVDC Transmission Lines”,by Fei Kong, Zhiguo Hao, Song Zhang, and Baohui Zhang, IEEE TRANSACTIONS ON POWER DELIVERY 2014[5]
6. “Reactive energy based protection schem” by jagdish s lahane ,government college of engineering Amravati,india
7. “A Pilot Directional Protection for HVDC Transmission Line Based on Relative Entropy of Wavelet Energy” by Sheng Lin , Shan Gao, Zhengyou He and Yujia Deng School of Electrical Engineering, Southwest Jiaotong University, Chengdu 610031, China
8. “Distance Protection Scheme for Series Compensated Transmission Lines” by Vanitha.V, Hemalatha.P M.P.N.M.J Engineering College, Erode, Tamilnadu, India.
9. “Novel Procedure for Protection Setting in an HVDC System Based on Fault Quantities”by Benfeng Gao , Ruixue Zhang† and Xuewei Zhang